

**Gujarat Water Supply & Sewerage Board,**

"Jal Bhavan", Sector-10-A,  
Opp. Air force Station,  
Gandhinagar-382010. Ph. (079) 23251092  
E-mail:- cematerial001@gmail.com



No.CE (Mat)/Vendor Selection/HDPPE/4265/452 Dt. 6/10/21

To,

M/s. Delta Irrigation LLP, Kolhapur  
Plot No. A-234, Kagal Five Star MIDC,  
Kolhapur-416236

E-mail:- info@deltairrigat.in

Sub: Selection of vendors for purchase of HDPE (PE 80 & 100) pipe by GWSSB

Ref: 1. Your proposal dtd. 22/11/2019 for Registration as vendor in HDPE (PE 80


& 100) pipes

2. Board Meeting 288 dtd.9-9-2021

Sir,

I am pleased to inform that your works located at Plot No. A-234, Kagal Five Star MIDC, Kolhapur-416236 has been given approval as vendor for purchase HDPE (PE 80 & 100) Pipe as detail mention below by Gujarat Water Supply & Sewerage Board for the use in drinking water system.

Sr. No.	Type of PIPE	Material	ISI Mark	Class	Up to Sizes Dia in mm
1.	HDPE Pipe	PE :80	With ISI Mark (IS 4984-2016)	PN 2.5	75 to 710 mm, SDR 41
				PN 3.2	75 to 710 mm, SDR 33
				PN 4.0	50 to 710 mm, SDR 26
				PN 5.0	40 to 710 mm, SDR 21
				PN 6.0	32 to 710 mm, SDR 17
				PN 8.0	25 to 710 mm SDR: 13.6
				PN 10.0	20 to 710 mm SDR: 11
				PN 12.5	20 to 500 mm, SDR 9
				PN 16.0	20 to 500 mm, SDR 7.4
				PN 20.0	20 to 500 mm, SDR 6
	PE :100	With ISI Mark (IS 4984-2016)		PN 3.0	75 to 710 mm, SDR 41
				PN 4.0	75 to 710 mm, SDR 33
				PN 5.0	50 to 710 mm, SDR 26
				PN 6.0	40 to 710 mm SDR:21
				PN 8.0	32 to 710 mm SDR:17
				PN 10.0	25 to 710 mm SDR:13.6
				PN 12.5	20 to 500 mm, SDR 11
				PN 16	20 to 500 mm, SDR 9
				PN 20	20 to 500 mm, SDR 7.4

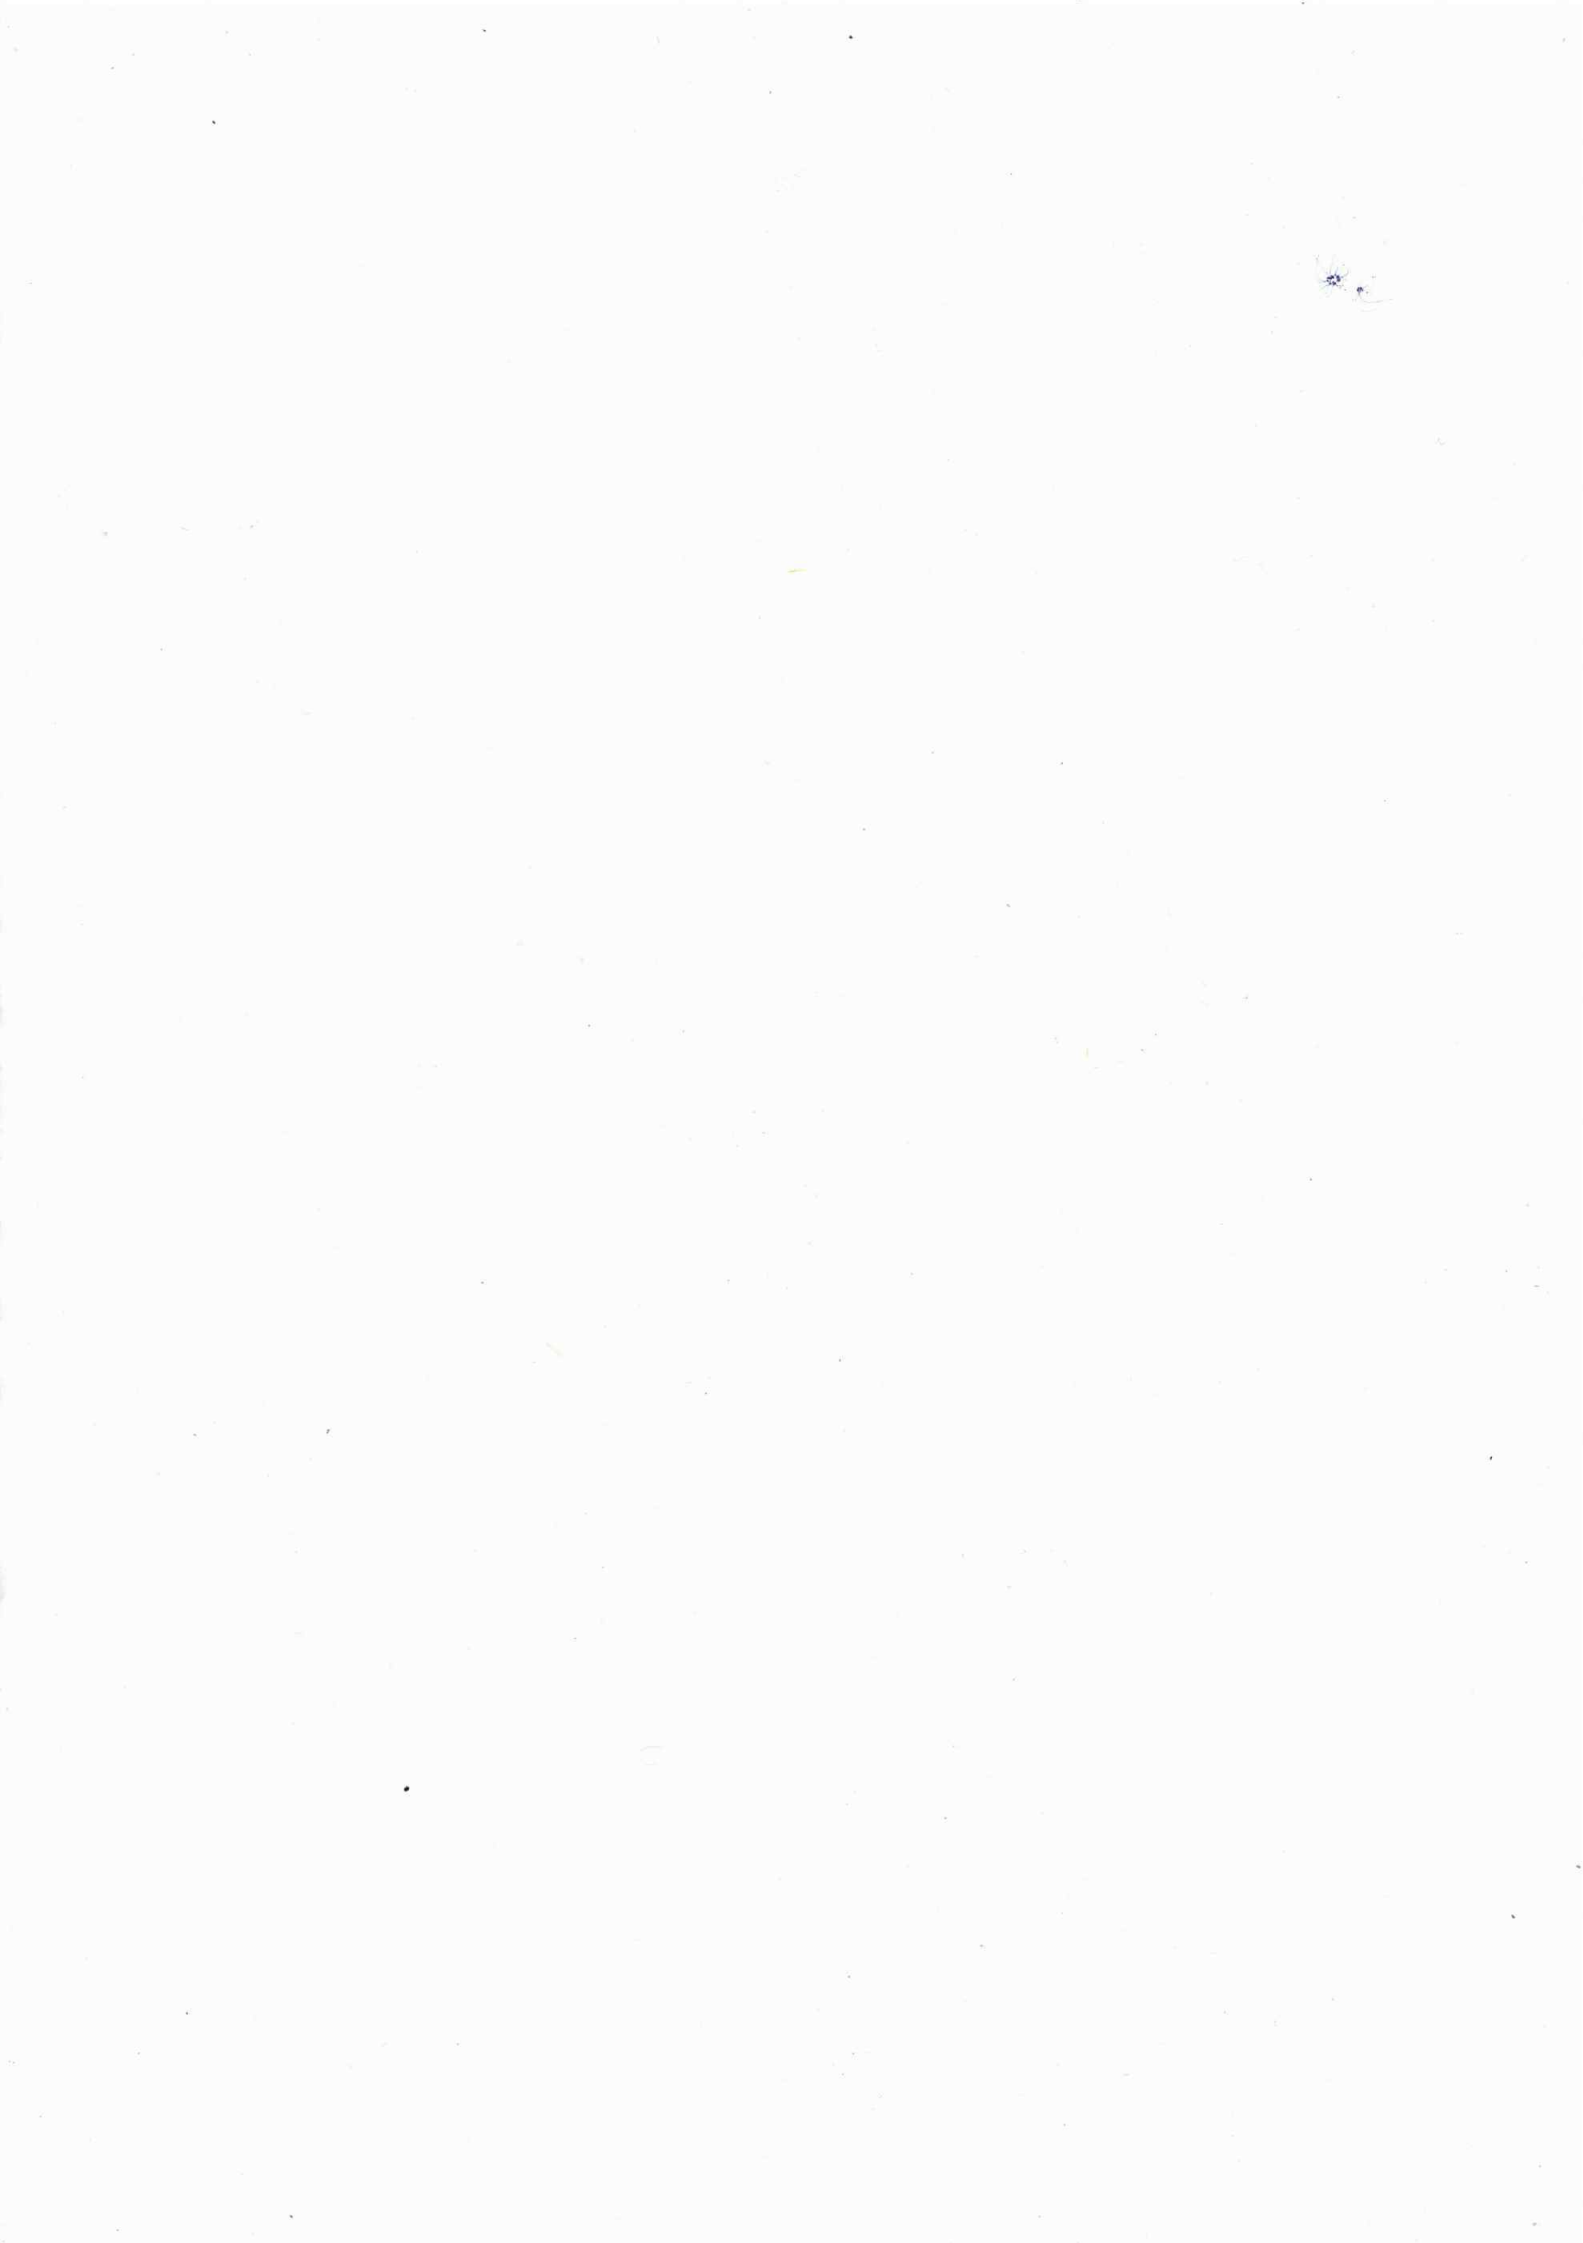

You have become eligible for participating in bidding process of Gujarat Water Supply & Sewerage Board for purchase of HDPE Pipe (PE 80 & 100) as mention above for turnkey / EPC tender works of GWSSB.


This registration is only for purchase of above commodity by Gujarat Water Supply & Sewerage Board and not for propagation furthering your interest of marketing by publication in news papers or advertising in any form.

The validity of registration will be up to 27-9-2024. However shifting of works or any addition / alteration activity carried out in works mentioned above will attract fresh shop survey & hence it shall be brought to the notice of GWSSB immediately.

This approval does not mean a guarantee to your firm for purchase of Items mentioned above by Gujarat Water Supply & Sewerage Board. The Gujarat Water Supply & Sewerage Board reserves right for cancellation of your firm from vendor list without assigning any reason.

You should have to apply for renewal / fresh approval well in advance i.e. three months prior to the expiry date of the registration / approval.  
Any discrepancy noticed in this letter should be brought to the notice of GWSSB within 10 days.

Yours sincerely,

  
Chief Engineer  
Material Cell (C)

C.C.to:

- 1 Chief Engineer, Zone - 1,2,3,4,5, 6/Vadodara /Ahmedabad / Rajkot /Bhuj/Junaghad/ Surat for Information.
- 2 Chief Engineer Mechanical Cell / Urban Cell, Gandhinagar for Information.
- 3 Chief General Manager, GWL, G'nagar for information.
- 4 WASMO, G'nagar for information.